






JOB #	TANK CAPACITY	GENSET MODEL	GENSET FOOTPRINT	TANK WEIGHT
10602	110 GAL	DCA70SSJU	35.43" x 94.50"	800 LBS

APPROVED BY: _____ DATE: _____

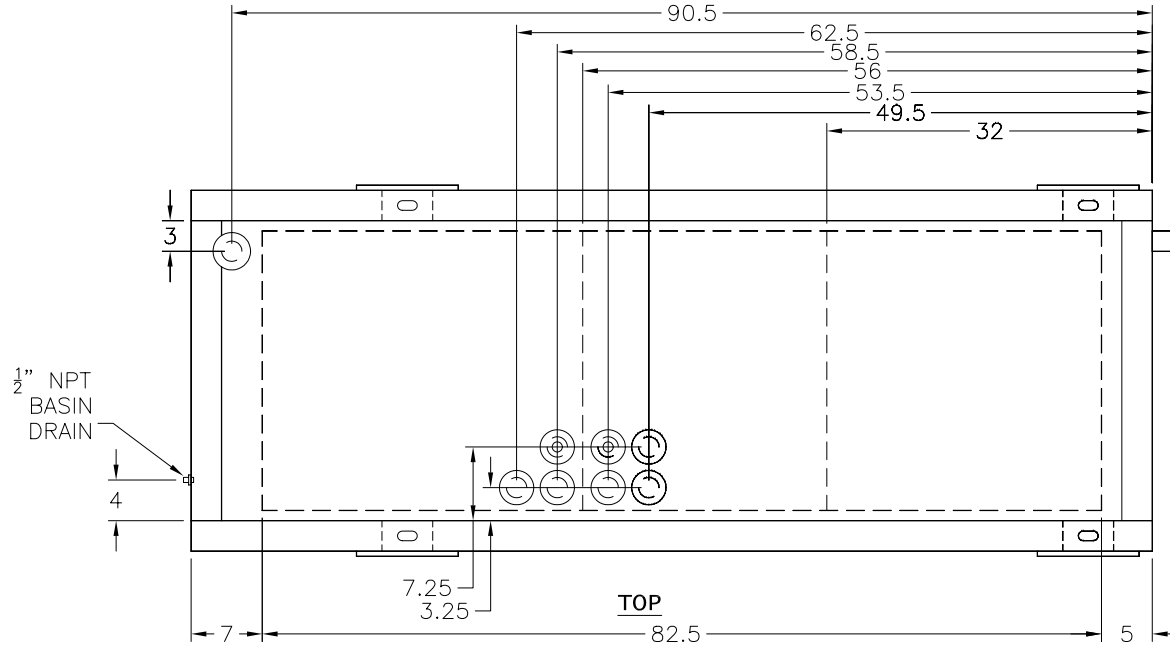

BILL OF MATERIAL		
LETTER	PART #	DESCRIPTION
S	3162	FLANGE, 2", E-VENT
T	3650	FLANGE, 2", RETURN, W/ 1/2" DIPTUBE
U	3650	FLANGE, 2", SUPPLY, W/ 1/2" DIPTUBE
V	1000	FLANGE, 2", LOW LEVEL
X	1003	FLANGE, 2", FUEL LEVEL GAUGE
Y	3152	FLANGE, 2", STD VENT
Z	3005	FLANGE, 2", FILL PORT/LOCKING CAP
A	4300	BASIN ALARM, TOP MOUNT
	3502	FLANGE, 1/2", BASIN DRAIN
	8410	FLUSH MOUNT LIFTING PLATES
	8420	BOTTOM ISOPAD SUPPORT PLATE
	DW-101	SECONDARY CONTAINMENT
		BLACK PAINT COLOR

NO GPC STICKERS ON TANK

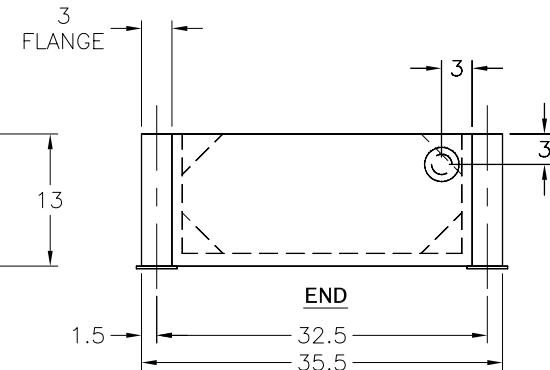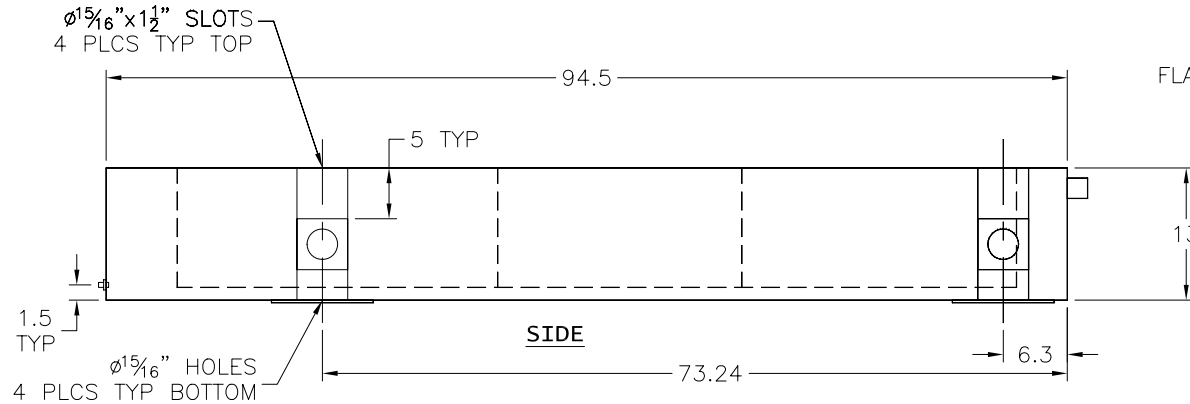

THIS AUTOCAD DRAWING IS THE PROPERTY OF GLOBAL POWER COMPONENTS AND MAY NOT BE USED IN ANY WAY DETRIMENTAL TO THE INTERESTS OF G.P.C. ANY MANUAL CHANGES WILL VOID THIS DRAWING. SPECIFICATIONS MAY CHANGE WITHOUT NOTICE. 1-1

REVISIONS			REVISIONS			SUB BASE TANK W/ RUPTURE BASIN & STUB UP	
REV	DATE:	CHANGE MADE	BY	REV	DATE:	CHANGE MADE	BY
						CUSTOMER/ID: MQ POWER	
						JOB REF: 24 HOUR TANK	
						QUOTE #: X	
						DWG #: 15-10602	
						DATE: 9/28/05	
						DRAWN BY: EHF	

