
INSTALLATION INSTRUCTIONS

Original Issue Date: 4/99


Model: 350 kW (Detroit Diesel Series 60)

Market: Industrial

Subject: Engine Block Heater Kits PA-343584, PA-343584-SD,
PA-343585, PA-343585-SD

The engine block heater kit heats engine coolant, making starting easier and warm-up quicker. The thermostat automatically turns off the heater when coolant temperature reaches 120°F (49°C). Observe the following safety precautions while installing the kit.

⚠ WARNING



Accidental starting.
Can cause severe injury or death.

Disconnect the battery cables before working on the generator set. Remove the negative (–) lead first when disconnecting the battery. Reconnect the negative (–) lead last when reconnecting the battery.

Disabling the generator set. Accidental starting can cause severe injury or death. Before working on the generator set or connected equipment, disable the generator set as follows:
(1) Move the generator set master switch to the OFF position.
(2) Disconnect the power to the battery charger. (3) Remove the battery cables, negative (–) lead first. Reconnect the negative (–) lead last when reconnecting the battery. Follow these precautions to prevent starting of the generator set by an automatic transfer switch, remote start/stop switch, or engine start command from a remote computer.

⚠ WARNING



Hot coolant and steam.
Can cause severe injury or death.

Before removing the pressure cap, stop the generator set and allow it to cool. Then loosen the pressure cap to relieve pressure.

Checking the coolant level. Hot coolant can cause severe injury or death. Allow the engine to cool. Release pressure from the cooling system before opening the pressure cap. To release pressure, cover the pressure cap with a thick cloth and then slowly turn the cap counterclockwise to the first stop. Remove the cap after pressure has been completely released and the engine has cooled. Check the coolant level at the tank if the generator set has a coolant recovery tank.

NOTE

Pay special attention to the coolant level. After draining the coolant, allow time for complete refill of the engine water jacket. Check coolant level as prescribed in the Prestart Checklist of the Operation Manual.

NOTE

Do not turn on block heater before filling cooling system. Run engine until warm and refill radiator to purge air from the system before energizing block heater. If heater element is not immersed in water, block heater will fail.

Installation

1. Place the generator set master switch in the OFF position.
2. Disconnect the power to the battery charger, if equipped.
3. Disconnect the generator set engine starting battery(ies), negative (–) lead first.
4. With the engine and the radiator cool, drain the coolant into a suitable container. Dispose of all waste materials (engine oil, fuel, coolant, etc.) in an environmentally safe manner. Contact your local authority for procedures and location.

NOTE

The coolant drain valve is located on the radiator bottom and/or on side of the engine crankcase.

5. **380/480 V:** Install the fuse block (X-6129-8) in the block heater control box (354316). Use the fuse block as a template and drill the mounting hole. Secure the fuse block to the control box with the screws (X-51-15), washers (X-25-48), and nuts (X-6210-4). See Figure 1 for the mounting location.


120–240 V: Control box 354315 uses an in-line fuse holder (269216). Install the in-line fuse and fuse holder at the time the block heater is wired.

6. **380/480 V:** Install the fuse (X-6135-6) in the fuse block installed in step 5.
7. Secure the block heater (279814 or 279815) to the block heater bracket (354687) with screws (X-465-7) and elastic stop nuts (X-101-8). Position the block heater as shown in Figure 2.
8. Secure the vibration isolators (259632) with lock washers (X-22-12) to the block heater bracket (354687). Secure one end of the ground strap (223033) between one of the vibromounts and the bracket. See Figure 2.
9. Secure the control box to the vibration isolators with hex cap bolts (X-465-6 and X-465-7) and lock washers (X-22-12). Secure the free end of the ground strap between the control box and vibration isolator with the 0.50 in. bolt (X-465-6). See Figure 2.
10. Mount the the block heater bracket to the generator set skid using two 3/8-16 x 1.25 in. hex cap bolts (X-6238-4), lock washers (X-22-14), and spirallock nuts (X-6210-9). See Figure 3.

NOTE


Apply pipe sealant to the male threads of all components before installing.

11. Remove the pipe plug from the upper right side of the engine block for the block heater outlet hose connection. See Figure 3.
12. Apply pipe sealant to the male threads on one end of the 3/4 x 4 in. pipe (A-107) and install the pipe where the pipe plug was removed from the engine block.

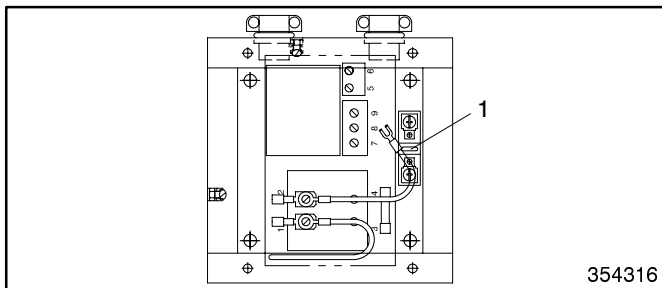


1. Fuse block mounting location

Figure 1. Block Heater Control Box—Top View

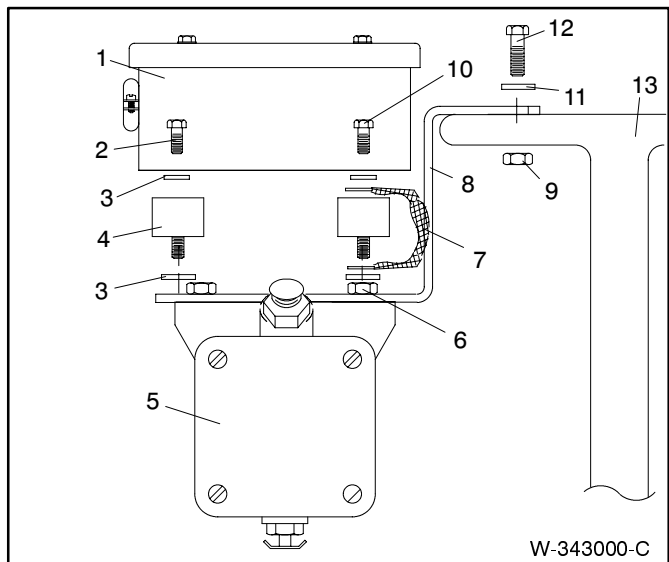


1. Block heater control box (354315 or 354316)
2. Hex cap bolt, 1/4-20 x 0.375 in. (X-465-17) (qty. 3)
3. Internal/external tooth lock washer, 1/4 in. (X-22-12)
4. Vibration isolator (259632)
5. Block heater (279814 or 279815)
6. Hex cap bolt, 1/4-20 x 1.0 in. (X-465-7) and 1/4-20 elastic stop nut (X-101-8)
7. Ground strap (223033)
8. Block heater bracket (354687)
9. Spirallock nut, 3/8-16 (X-6210-9)
10. Hex cap bolt, 1/4-20 x 0.50 in. (X-465-6)
11. Internal/external tooth lock washer, 3/8 in. (X-22-14)
12. Hex cap bolt, 3/8-16 x 1 1/4 in. (X-6238-4)
13. Generator set skid

Figure 2. Block Heater Control Box Mounting—End View

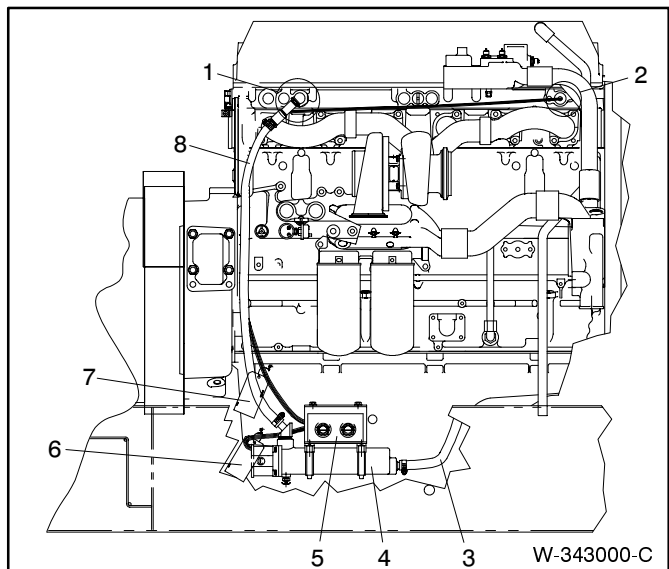


1. Block heater outlet connection, see Figure 4
2. Block heater thermostat
3. Hose, 4.6 ft. (1.4 m) (X-691-21) and hose clamps (X-426-12)
4. Block heater
5. Block heater control box
6. Instruction tag (279280)
7. Instruction tag (279047)
8. Hose, 3.7 ft. (1.1 m) (X-691-37) and hose clamps (X-426-12)

Figure 3. Block Heater Installation

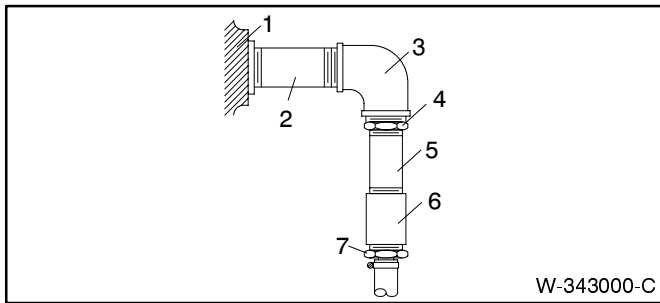


1. Engine block
2. Pipe, 3/4 x 4 in. (A-107)
3. Pipe elbow, 3/4 in. (X-215-2)
4. Reducer bushing, 1/2 x 3/4 in. (X-202-41)
5. Pipe, 1/2 x 4-1/2 in. (X-209-21)
6. Pipe coupling, 1/2 in. (X-216-20)
7. Hose connector, 1/2 in. (X-582-7)

Figure 4. Engine Block Outlet Hose Connections—Side View

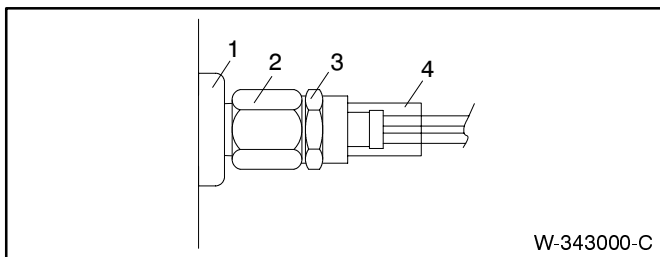

1. Freeze plug adapter
2. Thermostat housing
3. Sending unit
4. Heat shield


Figure 5. Block Heater Thermostat Assembly

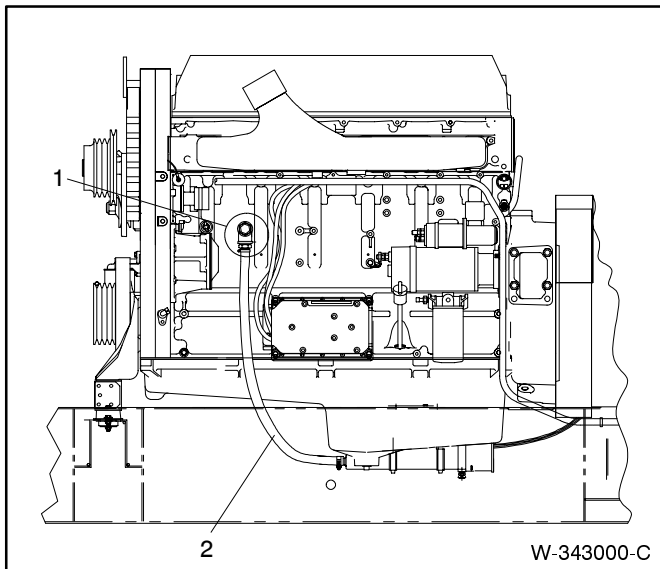

1. Block heater inlet hose connection, see Figure 7
2. Hose, 4.6 ft. (1.4 m) (X-691-21) and hose clamps (X-426-12)

Figure 6. Engine—Left Side View

13. Apply pipe sealant to the exposed male threads of the pipe installed in step 12 and install the 3/4 in. pipe elbow (X-215-2). Position the pipe elbow as shown in Figure 4.

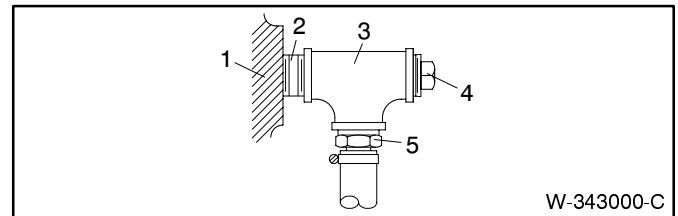


1. Engine block
2. Pipe nipple, 1/2 x 1-1/2 in. (X-209-5)
3. Pipe tee, 1/2 in. (X-203-13)
4. Pipe plug, 1/2 in. (X-75-28)
5. Hose connector, 1/2 in. (X-582-7)

Figure 7. Engine Block Inlet Hose Connections—Side View


14. Apply pipe sealant to the male threads of the 3/4 x 1/2 in. reducer bushing (X-202-41) and install the reducer bushing in the open end of the pipe elbow installed in step 13. See Figure 4.
15. Apply pipe sealant to the male threads on one end of the 1/2 x 4 1/2 in. pipe (X-209-21) and install the pipe in the reducer bushing installed in step 14. See Figure 4.
16. Apply pipe sealant to the exposed male threads of the pipe installed in step 15 and install the 1/2 in. pipe coupling (X-216-20). See Figure 4.
17. Apply pipe sealant to the male threads of the 1/2 in. hose connector (X-582-7) and install the hose connector in the end of the pipe coupling installed in step 16.
18. Remove the freeze plug from the right front side of the engine with a freeze plug puller, or puncture the center of the freeze plug and pry the plug out of the engine block. See Figure 3.
19. Clean and de-burr the hole where the freeze plug was removed.
20. Apply Loctite® threadlocker 272 (red) or equivalent material to the freeze plug adapter (324094) and the freeze plug hole.
21. Drive the freeze plug adapter into the engine block with a hardwood dowel and hammer. Keep the adapter flush with the outside surface of the engine block. Do not force the freeze plug adapter beyond the outside surface of the engine block into the engine water jacket.
22. Apply pipe sealant to the male threads of the thermostat housing and install the housing in the freeze plug adapter installed in step 21. Torque the housing to 15 ft. lbs. (20.3 Nm). See Figure 5.
23. Install the thermostat sending unit into the thermostat housing and torque the sending unit to 25 in. lbs. (2.8 Nm) and hold in place for 3 seconds. See Figure 5.

24. Route the thermostat leads along the engine wiring harness to the block heater control box. Use cable ties as necessary to protect and secure the wiring from sharp objects, exhaust system and moving parts.
25. Remove the pipe plug from the left side of the engine block for the block heater inlet hose connection. See Figure 8.
26. Apply pipe sealant to the male threads on one end of the 1/2 x 1 1/2 in. pipe nipple (X-209-5) and install the pipe nipple in the engine block where the pipe plug was removed in step 25. See Figure 9.
27. Apply pipe sealant to the exposed male threads of the pipe nipple installed in step 26 and install the 1/2 in. pipe tee (X-203-13). Position the pipe tee as shown in Figure 9.
28. Apply pipe sealant to the male threads of the 1/2 in. pipe plug (X-75-28) and install the pipe plug in the pipe tee. See Figure 9 for the installation location.
29. Apply pipe sealant to the male threads of the 1/2 in. hose connector and install the hose connector in the bottom of the pipe tee. See Figure 9.
30. Connect one end of the 3.7 ft. (1.1 m) hose (X-691-37) to the block heater outlet. Secure the hose to the block heater outlet with a hose clamp (X-426-12). Place the hose clamp 0.25 in. (6 mm) from the end of the hose and tighten the clamp.
31. Connect the free end of the hose connected to the block heater outlet to the hose connector on the right side of the engine. See Figure 3. Secure the hose to the hose connector with a hose clamp (X-426-12). Place the hose clamp 0.25 in. (6 mm) from the end of the hose and tighten the clamp.
32. Connect one end of the 5.4 ft. (1.6 m) hose (X-691-19) to the block heater inlet. Secure the hose to the block heater inlet with a hose clamp (X-426-12). Place the hose clamp 0.25 in. (6 mm) from the end of the hose and tighten the clamp.
33. Connect the free end of the hose connected to the block heater inlet to the hose connector on the left side of the engine. See Figure 8. Secure the hose to the hose connector with a hose clamp (X-426-12). Place the hose clamp 0.25 in. (6 mm) from the end of the hose and tighten the clamp.
34. Route the block heater and thermostat leads into the control box.
35. Use the wiring diagrams in Figure 10 to make the block heater control box electrical connections.
36. Remove the adhesive backing from the control box cover gasket (354318) and install the gasket on the backside of the control box cover (354317).

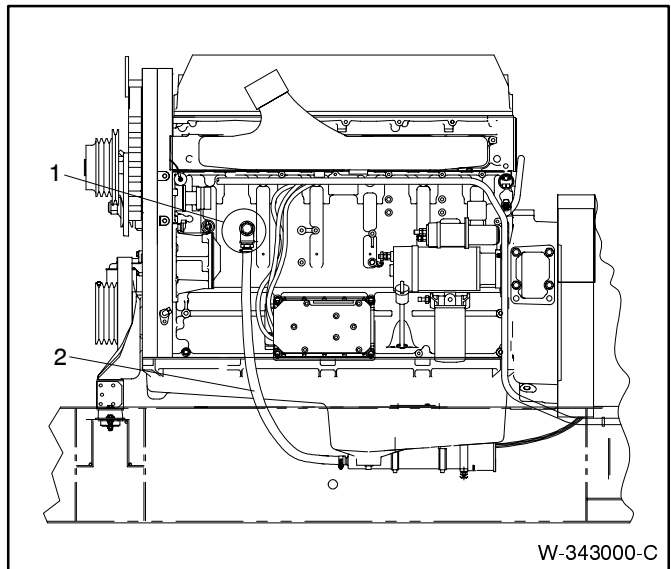

1. Block heater inlet hose connection, see Figure 9
2. Hose

Figure 8. Engine—Left Side View

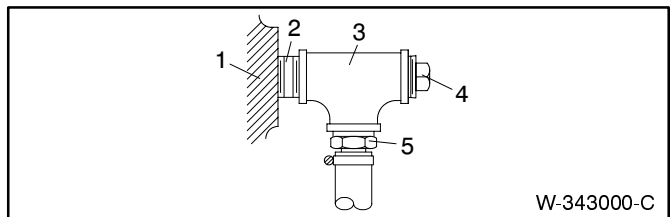

1. Engine block
2. Pipe nipple, 1/2 x 1 1/2 in. (X-209-5)
3. Pipe tee, 1/2 in. (X-203-13)
4. Pipe plug, 1/2 in. (X-75-28)
5. Hose connector, 1/2 in. (X-582-7)

Figure 9. Engine Block Inlet Hose Connections—Side View

37. Remove the adhesive backing from the wiring diagram label (354327 or 354328) and install the label on the backside of the control box cover.
38. Install the control box cover. Secure the cover to the control box with four screws (X-97-13) and washer gaskets (297001).
39. Remove the adhesive backing from the warning decal (354325 or 354326) and install the decal on the top center of the control box cover.

Block Heater

Parts List				
Kits: PA-343584, PA-343584-SD, PA-343585, PA-343585-SD			Unique Parts	
Qty.	Description	Common Parts	PA-343584 PA-343584-SD	PA-343585 PA-343585-SD
1	Pipe, 3/4 x 4 in.	A-107		
8	Washer, lock, 1/4 in. i/e tooth	X-22-12		
2	Washer, lock, 3/8 in. i/e tooth	X-22-14		
1	Washer, plain, i.d. = 0.188 in.			X-25-48
1	Screw, r.h.m., 8-32 x 1/2 in.			X-51-15
1	Plug, pipe, 1/2 in.	X-75-28		
4	Screw, hex head machine, 10-32	X-97-13		
4	Nut, elastic stop, 1/4-20	X-101-8		
1	Bushing, reducer, 1/2 x 3/4 in.	X-202-41		
1	Tee, pipe, 1/2 in.	X-203-13		
1	Nipple, pipe, 1/2 x 1 1/2 in.	X-209-5		
1	Pipe, 1/2 x 4 1/2 in.	X-209-21		
1	Elbow, pipe, 3/4 in.	X-215-2		
1	Coupling, pipe, 1/2 in.	X-216-20		
4	Clamp, hose, 1.25 in. max.	X-426-12		
1	Bolt, hex cap, 1/4-20 x 0.50 in.	X-465-6		
4	Bolt, hex cap, 1/4-20 x 1.0 in.	X-465-7		
3	Bolt, hex cap, 1/4-20 x 0.375 in.	X-465-17		
2	Connector, hose	X-582-7		
1	Hose, 4.6 ft. (1.4 m)	X-691-21		
1	Hose, 3.7 ft. (1.1 m)	X-691-37		
1	Block, fuse			X-6129-8
1	Fuse, 0.40 x 1.5, 600 V 10 A			X-6135-6
1	Nut, whiz, 8-32			X-6210-4
2	Nut, spiralock, 3/8-16	X-6210-9		
4	Bolt, hex cap, 3/8-16 x 1.25 in.	X-6238-4		
1	Strap, ground, 3/8 x 5 in.	223033		
4	Isolator, vibration	259632		
1	Holder, inline fuse		269216	
1	Tag, hang	279047		
1	Tag, instruction	279280		
1	Heater, block		279814	279815
1	Fuse, 0.25 x 1.25, 250 V 20 A		292937	
4	Gasket, washer	297001		
1	Adapter, freeze plug	324094		
1	Thermostat, block heater	343222		
1	Box, block heater control		354315	354316
1	Cover, block heater control box	354317		
1	Gasket, control box	354318		
1	Decal, warning		354325	354326
1	Label, wiring diagram		354327	354328
1	Bracket, block heater	354687		