


Lesson 3

OTPC Operator Menus

First Main Menu

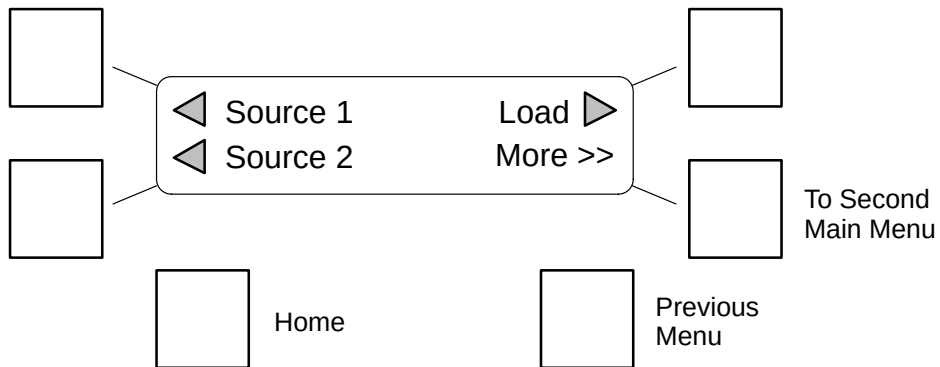

OTPC Operator Menu Symbols



Go on to the next menu



Go down one level in the menu system




Go up one level in the menu




Seen with “More” to go to the next Main menu

Navigating OTPC Menus

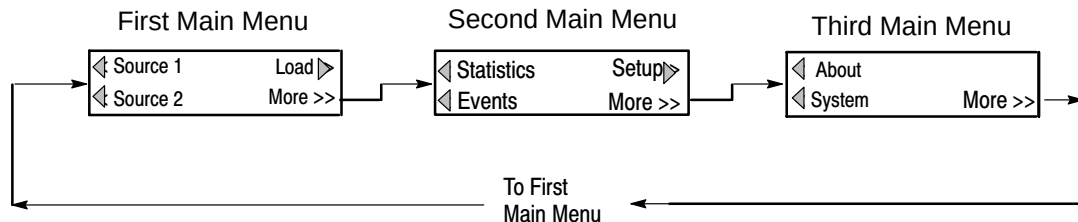

Source 1 or 2 Menu

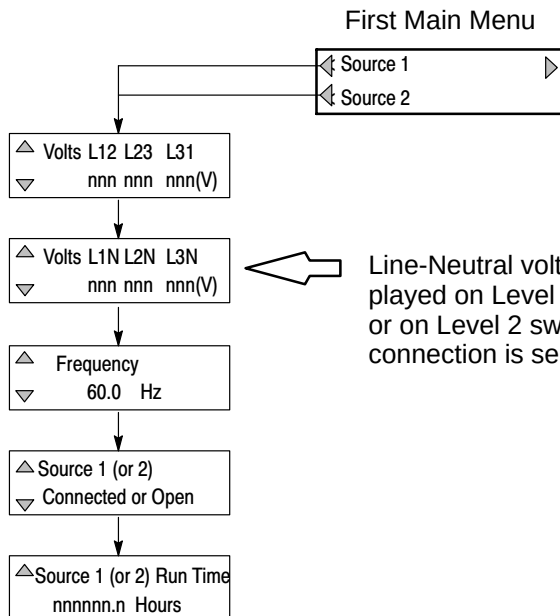

Line-Neutral voltages will not be displayed on Level 1 transfer switches, or on Level 2 switches when a Delta connection is selected.

Load Menu



First Main Menu

◀ Source 1	Load ▶
◀ Source 2	More >>

△ Volts L12 L23 L31
▽ nnnnnnnn (V)

△ Volts L1N L2N L3N
▽ nnnnnnnn (V)

△ Amps I1 I2 I3
▽ nn nn nn (A)

△ Frequency
▽ 60.0 Hz


△ Real Power kW
▽ nnnn.n

△ Apparent Power kVA
▽ nnnn.n

△ Power Factor
▽ nn.n (Lag)

△ Neutral Current
nnnn Amps


Second Main Menu

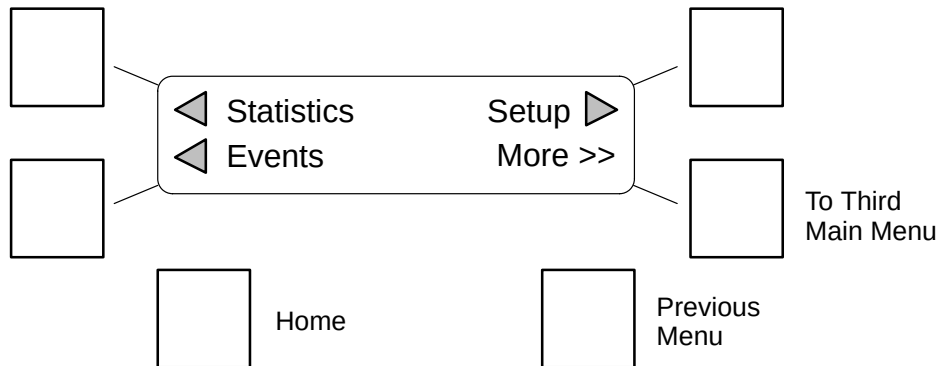

Statistics Menu



Second Main Menu

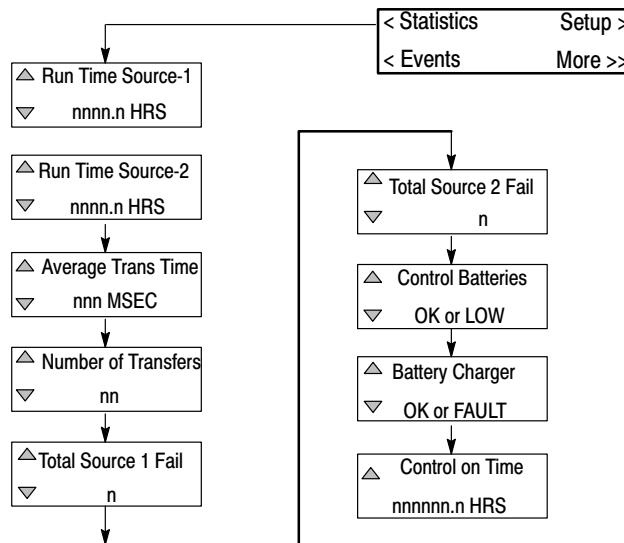

Events Menu



Second Main Menu

< Statistics	Setup >
< Events	More >>

△ Most Recent
▽ dd/mm/yy hh/mm/ss


△ 2nd Most Recent
▽ dd/mm/yy hh/mm/ss

△ 3rd Most Recent
▽ dd/mm/yy hh/mm/ss

△ 4th Most Recent
▽ dd/mm/yy hh/mm/ss

△ 50th Most Recent
dd/mm/yy hh/mm/ss


Third Main Menu

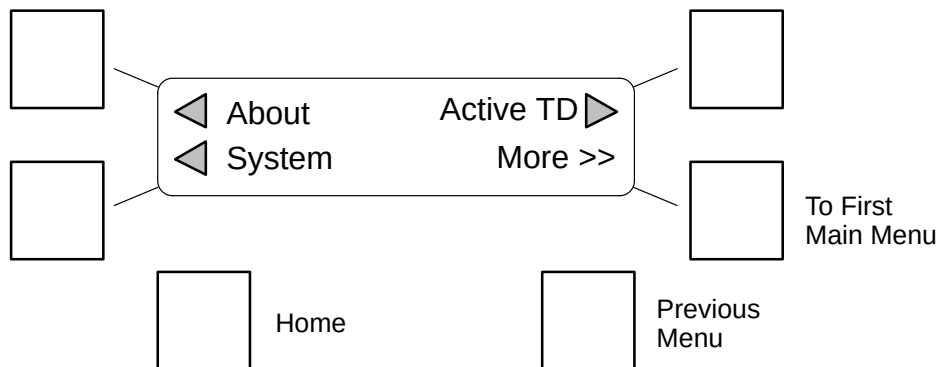

About Menu




Third Main Menu

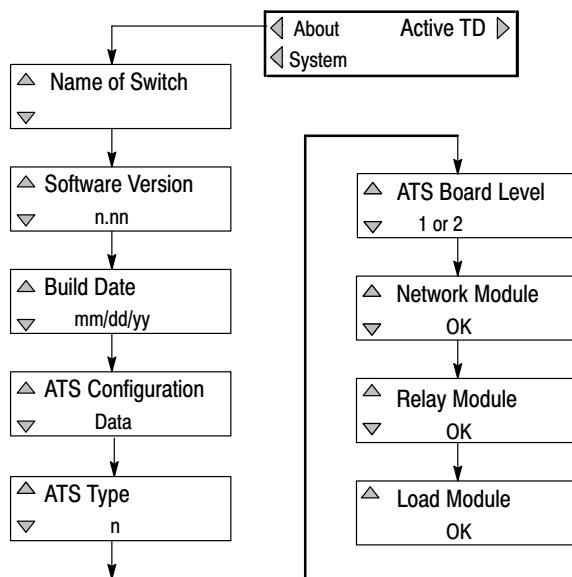

System Menu




Third Main Menu

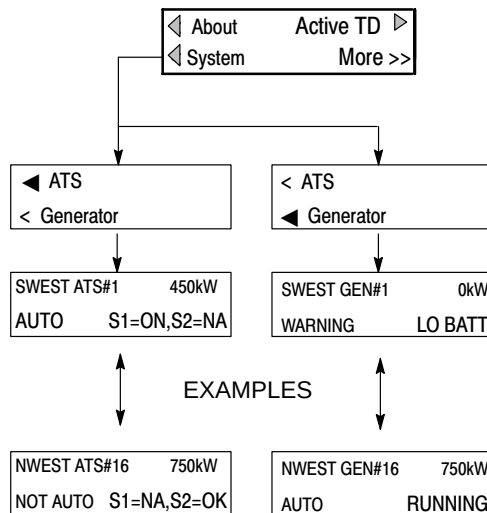

Active Time Delay Menu



Third Main Menu



Active TD and Count

3-1 Operator Menus Exercise

3-2 Operator Menu Quiz